

Chameleon Flooring Pty Ltd

TEST REPORT

SCOPE OF WORK SPC flooring

REPORT NUMBER


230215101SHF-002

TEST DATE(S) 2023-02-16 - 2023-03-02

ISSUE DATE 2023-03-02

PAGES 5

DOCUMENT CONTROL NUMBER LFT-APAC-SHF-OP-10k(March 1, 2023) © 2023 INTERTEK

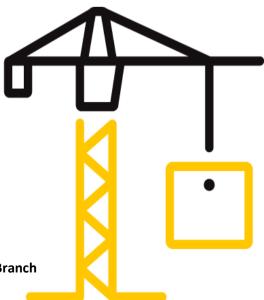

Intertek Testing Services Shenzhen Ltd. Shanghai Fengxian Branch



Intertek Testing Services Shenzhen Ltd. Shanghai Fengxian Branch Plant 5, No. 6958 Daye Road, Fengxian District, Shanghai, China Tel: 021-61136116 Fax: 021-61189921 Website: www.intertek.com

Test Report

Statement

1. This report is invalid without company's special seal for testing on assigned page.

2. This report is invalid without authorized person's signature.

3. This report is invalid where any unauthorized modification indicated.

4.Don't copy this report in partial (except full copy) without any official approval in written by our company. This report is invalid without re-stamping the special seal for testing in copying report.

5.Any holder of this document is advised that this report is for the exclusive use of Intertek's Customer and is provided pursuant to the agreement between Intertek and its Customer. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. This report was made with due care within the limitation of a defined scope of work and on the basis of information, materials and instructions received from the Customer or its nominated third parties. Intertek is under no obligation to refer to or report upon any facts or circumstances which are outside the specific instructions received and accepts no responsibility to any parties whatsoever, following the issue of the report, for any matters arising outside the agreed scope of the works. The tests results are not intended to be a recommendation for any particular course of action. Customer is responsible for acting as it sees fit on the basis of such results.

6.Intertek's written consent is required to use Intertek's name or logo on the object, product or service being tested. The observations and test results in this report relate only to the sample under test. This report alone does not indicate that the item, product or service has passed any Intertek certification program.



Intertek Testing Services Shenzhen Ltd. Shanghai Fengxian Branch Plant 5, No. 6958 Daye Road, Fengxian District, Shanghai, China Tel: 021-61136116 Fax: 021-61189921 Website: www.intertek.com

Test Report

Issue Date:	2023-03-02	Intertek Report No.	230215101SHF-002
Applicant:	Chameleon Flooring Pty Ltd		
Address:	U25/284 Musgrave Road, Coopers Plains, O	LD 4108	
Attn:	Wendy		
Test Type:	Performance test, samples provided by the	applicant.	

Product Information

Product Name		SPC flooring	Brand	Pallas Hybrid
Sample		Good Condition	Sample Amount	12 pieces
Description		Good condition	Received Date	2023-02-15
Sample ID		Model	Specification	
S230215101SHF.001		Spotted gum	1540 x 182 x 7.5mm	

Test Methods And Standards

Test Standard	EN ISO 9239-1:2010
Specification Standard	/
Test Conclusion	The samples were tested according to the above standards, and the results are shown in the following page.

Note:

1. This report relates specifically to the sample(s) that were drawn and provided by the applicant or their nominated third party. The reported result(s) provide no warranty or verification on the sample(s) representing any specific goods and/or shipment and only relate to the sample(s) as received and tested.

Report Authorized

Name: Sallý Xie Title: Reviewer





Test Report

Issue Date:

2023-03-02

Intertek Report No. 230215101SHF-002

Test Items, Method and Results:

1 TEST STANDARD

The test was conducted in accordance with EN ISO 9239-1:2010 Reaction to fire tests for floorings, Part 1: Determination of the burning behaviour using a radiant heat source. This test evaluates the wind-opposed burning behavior and spread of flame of horizontally mounted floorings exposed to a heat flux radiant gradient in a test chamber, when ignited with pilot flames.

2 RESULTS AND OBSERATIONS

Method	Parameter	Result
	Critical flux (transverse), kW/m ²	≥11.0
EN ISO 9239-1:2010	Critical flux (longitudinal), kW/m ²	≥11.0
	Smoke production, % minutes	313

3 Test Photos



Before test




After test



Test Report

Issue Date: 2023-03-02 Intertek Report No. 230215101SHF-002

Appendix A: Sample Received Photo

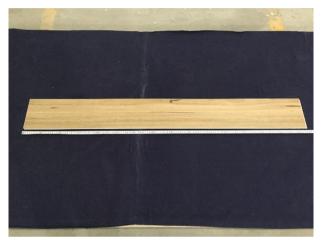

Front View (Test Face)



Back View

Revision:

NO.	Date	Changes	Author	Reviewer
230215101SHF-002	2023-03-02	First issue	Tod Qian	Sally Xie